


PRIVATE SEWER IN PUBLIC
RIGHT-OF-WAY
(SEE CITY SPECIFICATION
FOR MATERIAL REQUIREMENT)

PRIVATE SEWER
(SEE NOTE 2)

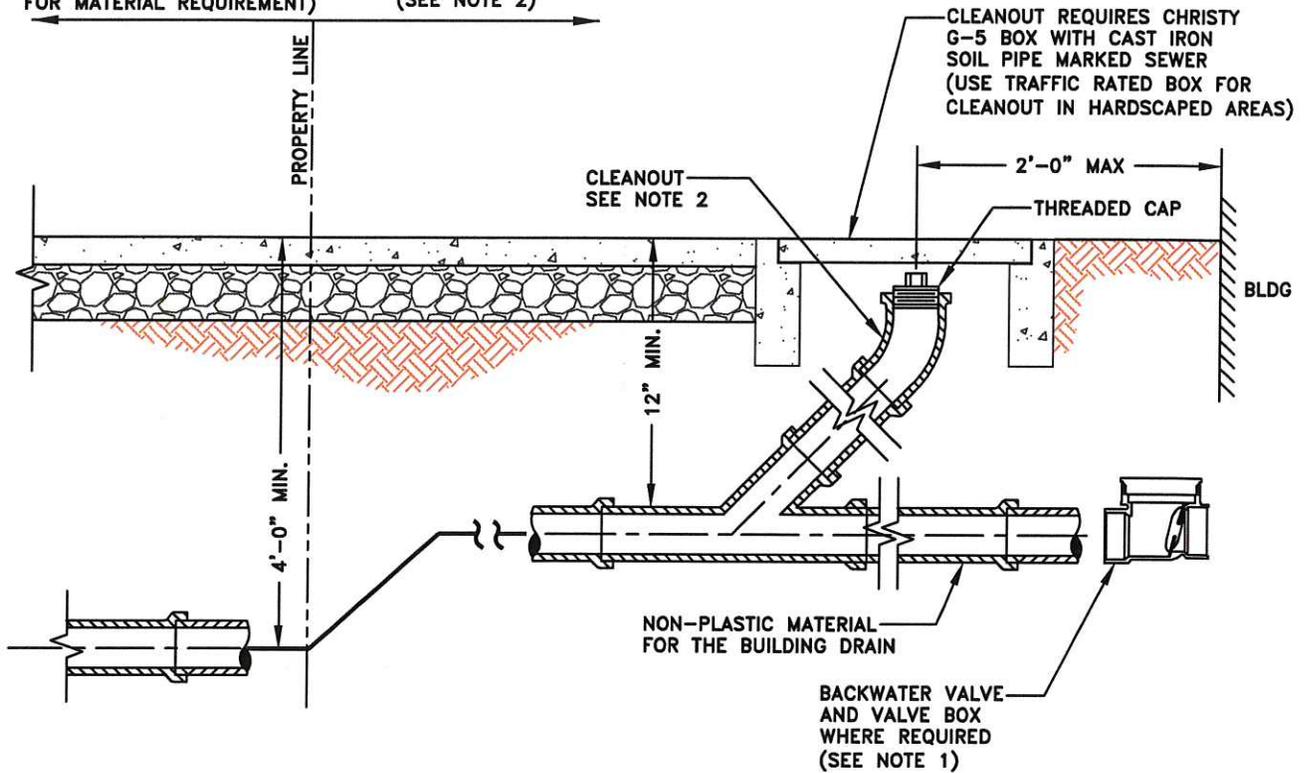

**ONE-WAY CLEAN OUT
SECTION**

NOTES:

1. BACKWATER VALVE IS REQUIRED WHEN SLOPE OF SEWER LATERAL FROM BUILDING TO SEWER MAIN IS LESS THAN 2% OR WHEN THE LOWEST FIXTURE IN THE BUILDING IS BELOW THE RIM OF THE NEXT DOWNSTREAM MANHOLE.
2. CLEANOUT AND BUILDING SEWER PIPE SHALL BE PE SCHEDULE 11 OR 17 OR PVC SDR 26 OR 35.
3. SEWER RUNS OF 50 FEET OR LONGER MAY, AT THE OPTION OF THE CITY ENGINEER/DWWR, REQUIRE AN ADDITIONAL CLEANOUT.
4. CONTRACTOR SHALL OBTAIN PERMIT FROM ENGINEERING DIVISION FOR WORK FROM SEWER MAIN TO 2' FROM THE BUILDING.



CITY OF DALY CITY, CALIFORNIA
NORTH SAN MATEO COUNTY SANITATION DISTRICT

STANDARD
DETAIL

CLEAN OUT & BACKWATER VALVE

SS-10

REVIEWED BY: 
DWWR DIRECTOR

ADOPTED ON: JAN 14, 2019
BOARD OF DIRECTORS

DATE: NOV 2018