


PLANS-CHANNELIZED MANHOLE BOTTOMS



NOTES:

1. MANHOLE BARREL & MANHOLE COVER DIAMETERS SHALL VARY WITH PIPE DIAMETER (SEE SPECIFICATIONS).
2. PRECAST MANHOLE SECTIONS SHALL BE FURNISHED WITHOUT STEPS OR LADDER RUNG.
3. CONCRETE SURFACE BLOCK SHALL BE Poured 2 INCHES BELOW FINAL FINISH GRADE TO ACCEPT ASPHALT OVERLAY.
4. CAST IN PLACE MANHOLE BASE SHALL BE USED ONLY WITH PRIOR APPROVAL BY THE CITY ENGINEER.
5. THE TOP HALF OF PVC PIPE SHALL BE REMOVED TO THE CONTOUR OF THE INSIDE OF ALL MANHOLES AND THE BROKEN EDGES SHALL BE PLASTERED SMOOTH WITH CEMENT.

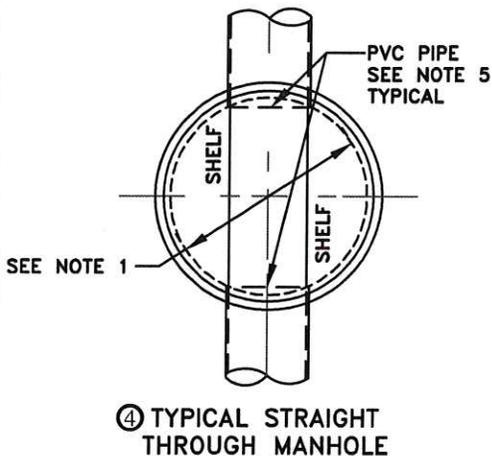

CITY OF DALY CITY, CALIFORNIA
NORTH SAN MATEO COUNTY SANITATION DISTRICT

STANDARD
DETAIL

SANITARY SEWER MANHOLE - CAST IN PLACE

SS-4

REVIEWED BY: *[Signature]*
DWWWR DIRECTOR

ADOPTED ON: JAN 14, 2019
BOARD OF DIRECTORS

DATE: NOV 2018