NOTES:

1. WHEN ROOT PRUNING EXCESSIVELY LARGE ROOT SYSTEMS ALONG SIDEWALK PROVIDE 18" OR 24" BARRIER AS SPECIFIED OR DIRECTED.
2. ALWAYS CONSULT PARKS DEPARTMENT BEFORE ROOT PRUNING.

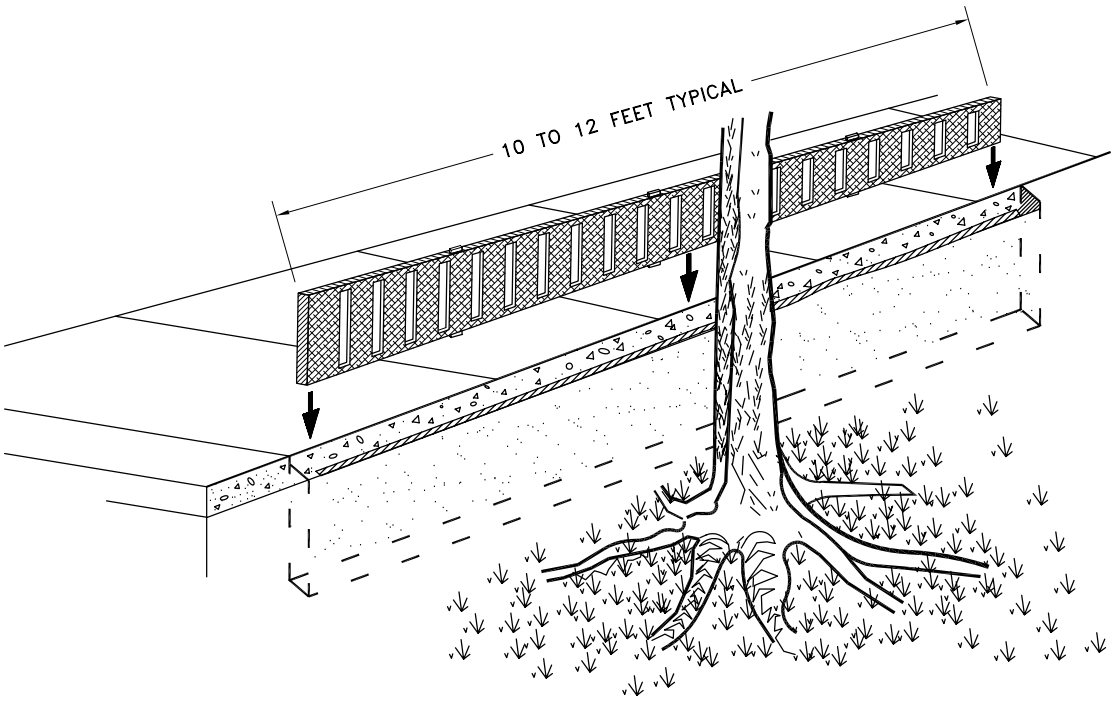

ROOT CONTROL BARRIER INSTALLATION
SIDEWALK APPLICATION
NTS

NOTES:

1. TOP OF ROOT CONTROL BARRIER MUST BE AT GRADE (NEVER BELOW GRADE)
2. POSITION ROOT CONTROL BARRIER AGAINST STRUCTURE OR AS CLOSE TO STRUCTURE AS POSSIBLE
3. DURING CONSTRUCTION THE ROOT CONTROL BARRIER CAN BE PLACED AGAINST THE INSIDE OF THE FORMS.
4. THE RAISED ROOT DEFLECTORS MUST BE FACING TOWARD THE TREE.
5. BARRIER MUST EXTEND AT LEAST 8" BELOW THE BOTTOM OF LANDSCAPE.
6. SEE STD. DWG. PR-4 FOR TYPICAL MATERIAL SPECIFICATION FOR BARRIER.

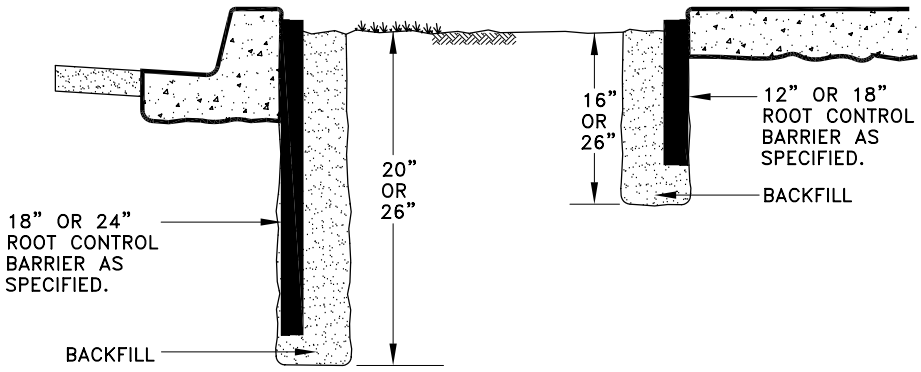

ROOT CONTROL BARRIER PLACEMENT
NTS

CITY OF DALY CITY, CALIFORNIA — DEPARTMENT OF PUBLIC WORKS

ROOT CONTROL BARRIER – DETAILS

DRAWN BY : A. TAN

DATE: 6/03 — APPROVED BY: MP Sharma, CITY ENGINEER — STANDARD DRAWING NO. PR-3

Reviser: andy tan
Dwg File: N:\SDAF\Andy\Mike\STANDARD\PR-3.DWG
Time: 15:32:25
Date: 5/19/1999