



NOTE: 1. TEST TEES TO BE PLACED IN LINES AT INTERVALS HAVING A MAXIMUM OF 15 FOOT ELEVATION DIFFERENTIAL; INTERVALS MAY BE EQUAL DIVISIONS OF ELEVATION OR DISTANCE BETWEEN STRUCTURES, SUCH INTERVALS HAVING A MAXIMUM OF 15 FOOT ELEVATION DIFFERENTIAL.

2. SEWER LATERAL REPAIRS USING 3 OR MORE COUPLINGS REQUIRE TESTING.

PROFILE

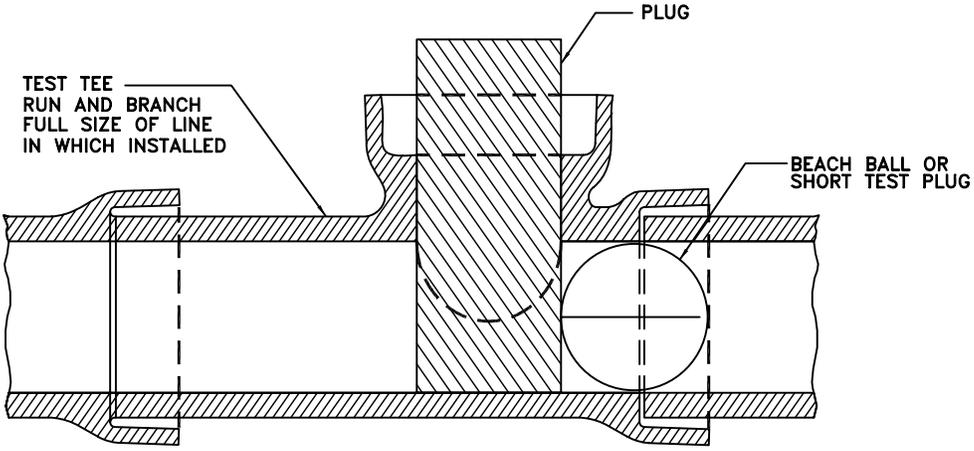

SECTION - TEST TEE

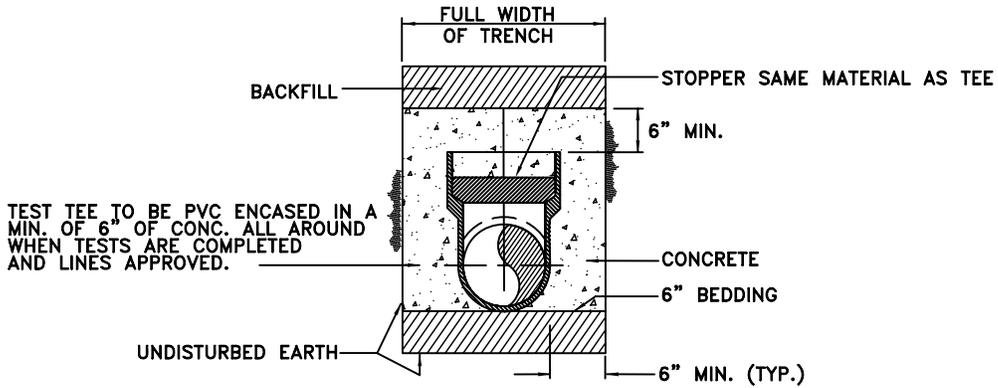

TEST TEE ENCASEMENT