
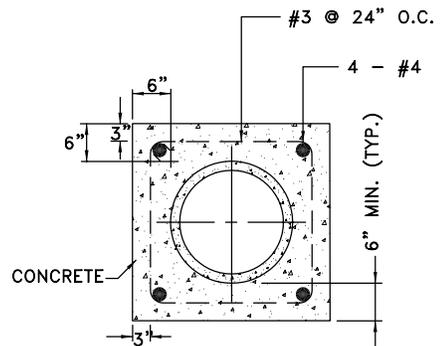


NOTES:

1. MINIMUM SLOPE FOR 6-INCH SIDE SEWER SHALL BE 1/4" PER FOOT.
2. L = WIDTH OF STORM DRAIN TRENCH PLUS EXTENSION AT BOTH SIDES TO FIRST PIPE JOINT AT OR BEYOND TRENCH

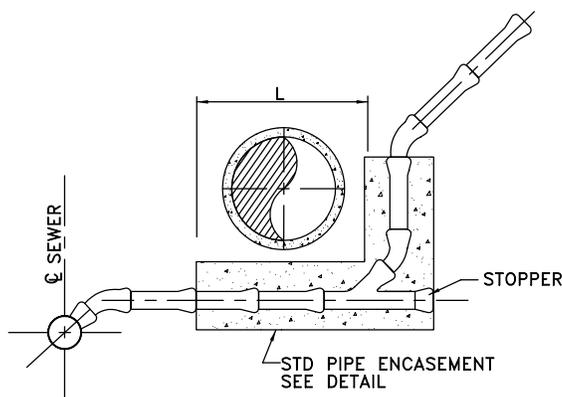

STANDARD PIPE ENCASEMENT DETAIL

CITY OF DALY CITY, CALIFORNIA

N.S.M.C.S.D.

DRAWN BY : A.TAN

SIDE SEWERS AT UTILITY INTERSECTIONS

DATE: 6/03

APPROVED BY: MP Shama, CITY ENGINEER

STANDARD DRAWING NO. SS-9