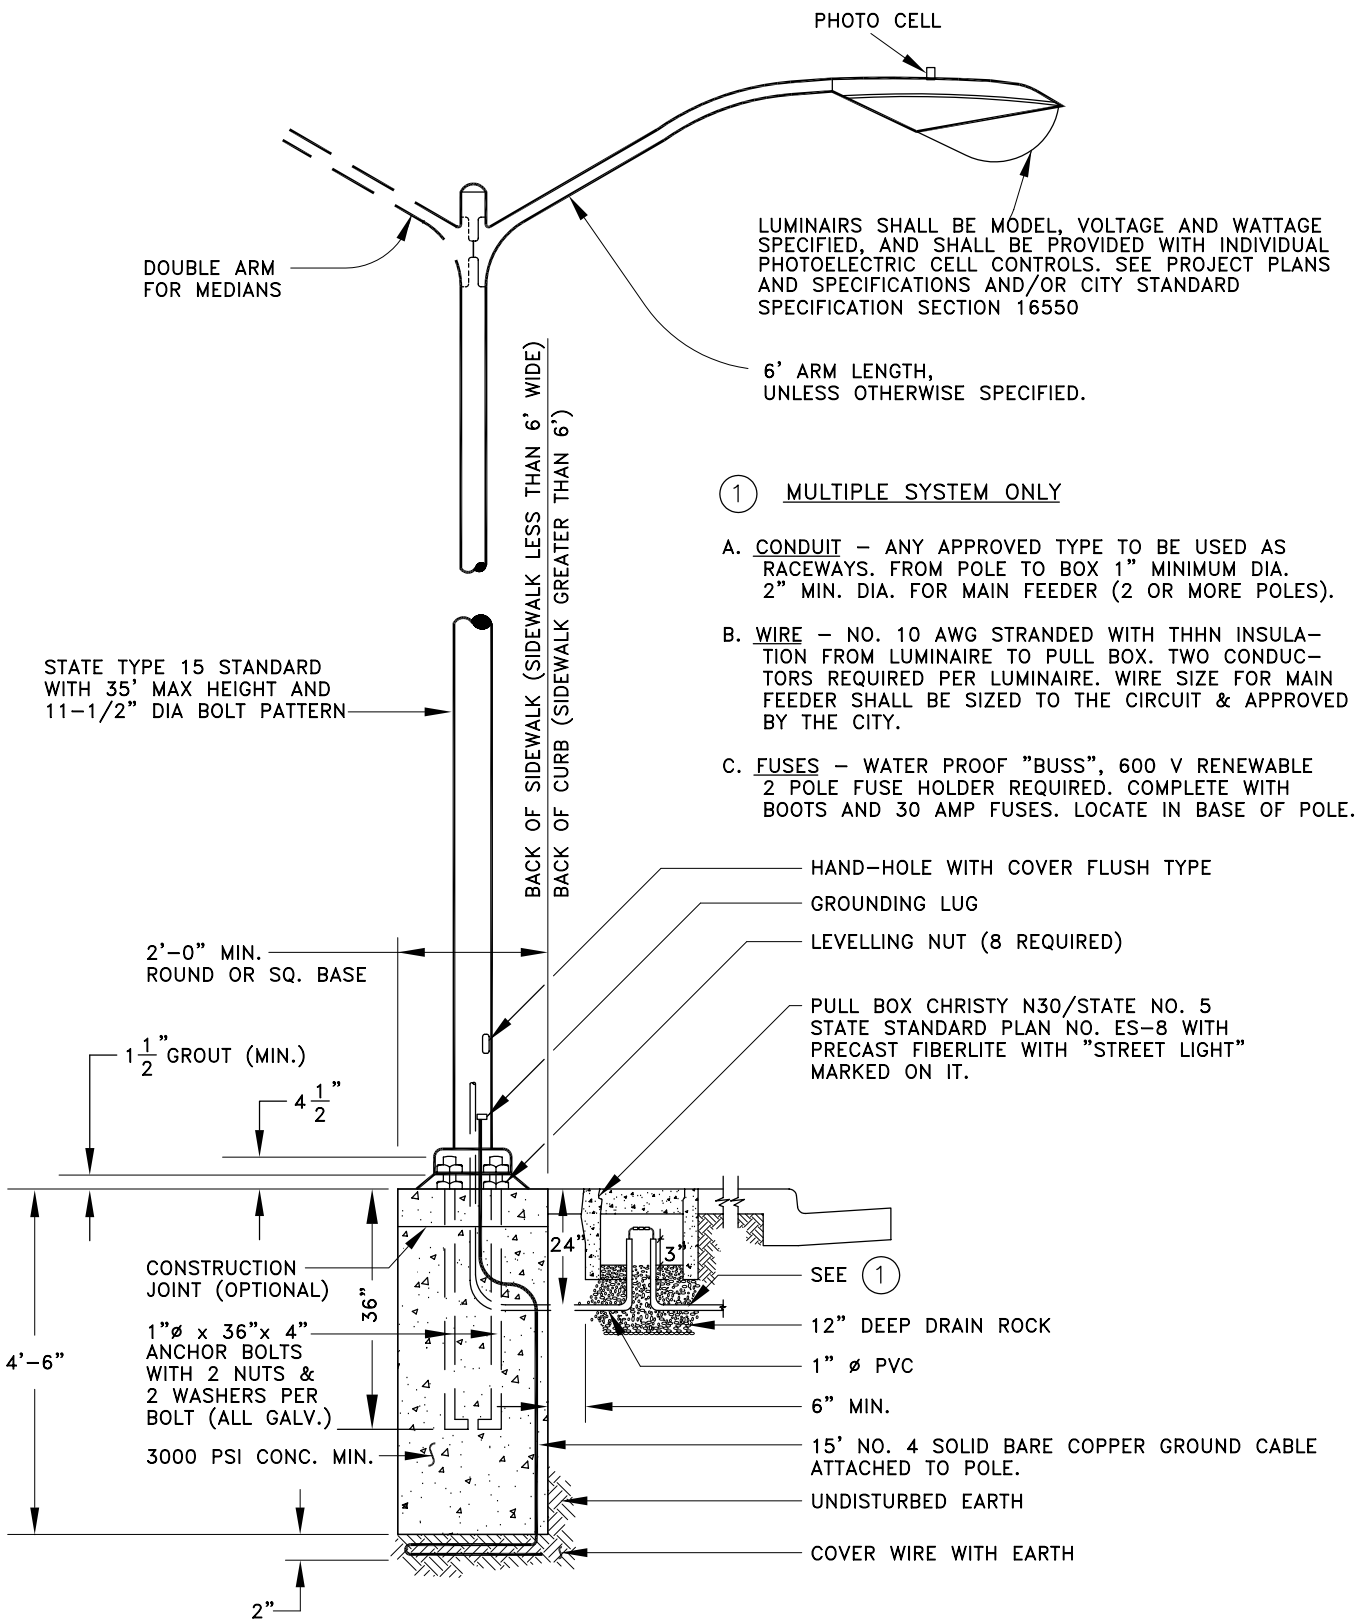

ELEVATION

1 MULTIPLE SYSTEM ONLY

A. CONDUIT – ANY APPROVED TYPE TO BE USED AS RACEWAYS. FROM POLE TO BOX 1" MINIMUM DIA. 2" MIN. DIA. FOR MAIN FEEDER (2 OR MORE POLES).

B. WIRE – NO. 10 AWG STRANDED WITH THHN INSULATION FROM LUMINAIRE TO PULL BOX. TWO CONDUCTORS REQUIRED PER LUMINAIRE. WIRE SIZE FOR MAIN FEEDER SHALL BE SIZED TO THE CIRCUIT & APPROVED BY THE CITY.

C. FUSES – WATER PROOF "BUSS", 600 V RENEWABLE 2 POLE FUSE HOLDER REQUIRED. COMPLETE WITH BOOTS AND 30 AMP FUSES. LOCATE IN BASE OF POLE.

CITY OF DALY CITY, CALIFORNIA — DEPARTMENT OF PUBLIC WORKS

TYPICAL STREET LIGHTING

DRAWN BY : A. TAN

DATE: 02/04 APPROVED BY: MP Sharma, CITY ENGINEER STANDARD DRAWING NO. S-10

Revised: andy tan
Dwg File: N:\Staff\Andy\Misc\STANDARD\S-10.dwg
Time: 8:22:59
Date: 6/22/1999