






Power Supply Cords



The power supply cord is buried in the ground or encased in concrete. Remove the dirt or concrete covering and if deteriorated, replace the power supply cord. [25 CCR 1188(b), 1352(g), 2352(f)]

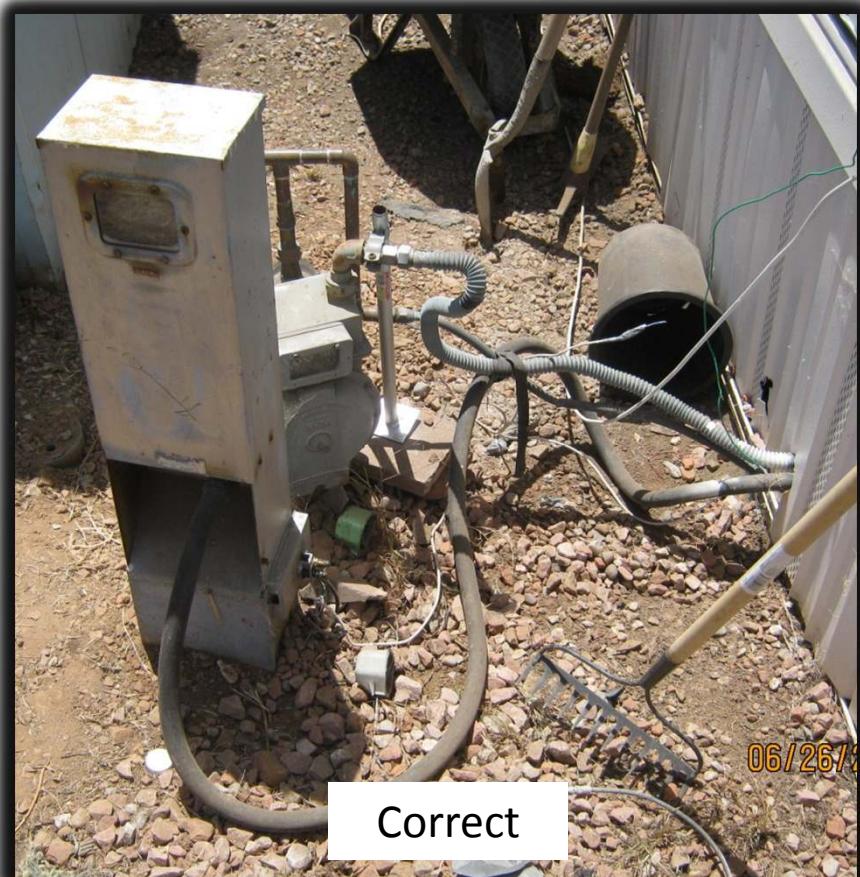

Power Supply Cords

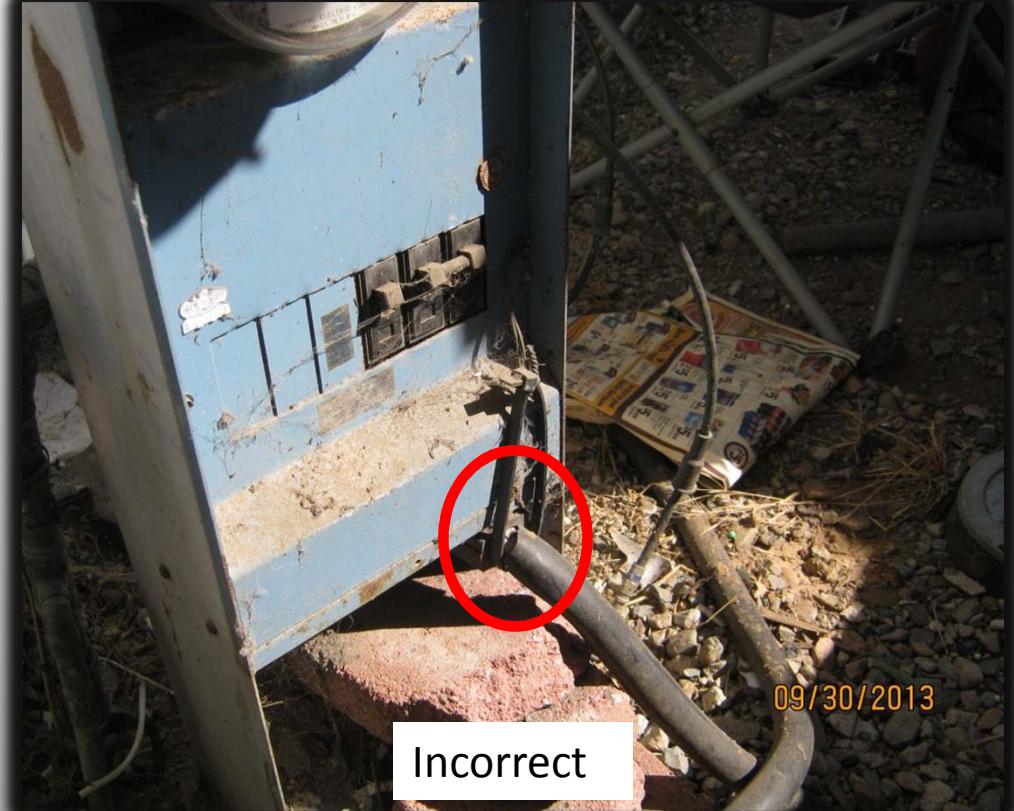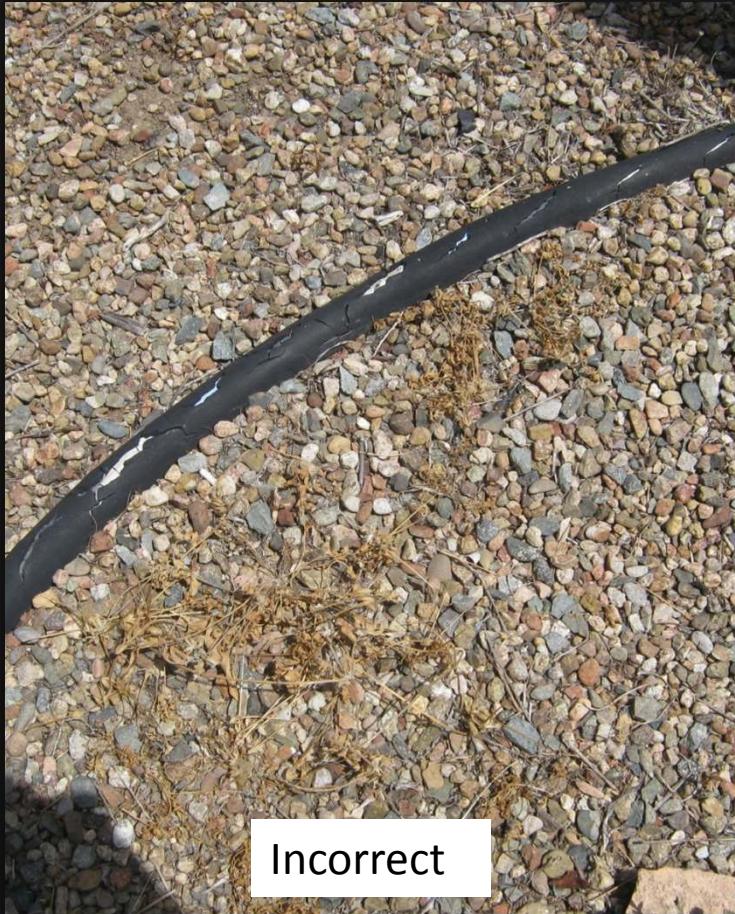

The power cord covering is cracked or deteriorated exposing the conductors. Replace the cord with a cord listed for manufactured home/mobilehome or recreational vehicle use, as appropriate. [25 CCR 1352(a)(1), 1606(d), 1607(d)]



Feeder Assemblies



The MH-unit electrical supply conduit is buried or in direct contact with the earth. Uncover the supply conduit and support above grade. [25 CCR 1352(e), 2352(f)]